


# NOTES

- 1) RADIO EQUIPMENT ROOM: PROVIDE 4" FLAT BLACK VINYL COVE BASE CLUED TO WALLS ALL AROUND. PATCH AND REPAIR EXISTING EPOXY PAINT ON FLOOR AS NECESSARY. BATTERY ROOM AND UPS AREA: PATCH AND REPAIR EXISTING EPOXY PAINT ON FLOOR AS NECESSARY.
- 2) PROVIDE A MIN. OF (2) FINISH COATS SEMI-GLOSS ENAMEL FOR THE ENTIRE ROOM WALLS OF RADIO EQUIPMENT, BATTERY ROOM, CEILING OF BATTERY ROOM AND UPS AREA. ALL NEW WALLS AND CEILING SHALL ALSO HAVE A LATEX PRIMER COAT.
- 3) RADIO EQUIPMENT ROOM WALL SHALL BE TWO 5/8" TYPE X GYPSUM WALLBOARD ON BOTH SIDES OF 3 5/8" METAL STUDS 25 GAGE AT 16" ON CENTER WITH 3 1/2" THICK R-11 FIBERGLASS INSULATION CONSTRUCTED FROM FLOOR TO SLAB.
- 4) BATTERY ROOM WALLS SHALL BE TWO 5/8" TYPE X GYPSUM WALLBOARD ON BOTH SIDES OF 3 5/8" "C" STUDS UNPUNCHED 18 GAGE AT 16" ON CENTER WITH 3 1/2" R-11 FIBERGLASS INSULATION. BATTERY ROOM CEILING TO BE CONSTRUCTED OF 8" X 2" "C" JOISTS, 18 GAGE CEILING JOISTS AT 16" O.C. WITH 3/4" FIRE-RETARDANT PLYWOOD WITH (2) LAYERS 5/8" TYPE X GYPSUM BOARD ON BOTH SIDES OF JOISTS AND 8 1/4" R-19 FIBERGLASS INSULATION.
- 5) PROVIDE METAL FRAME FOR DOUBLE DOORS, 1 1/2 HOUR UL RATED, MAXIMUM 18 GAGE STEEL FRAME AND DOOR MINIMUM 18 GAGE, 1 3/4" HOLLOW METAL DOORS, 1 1/2 HOUR UL RATED IN LOCATIONS SHOWN ON PLAN. DOOR LOCKSET TO BE CORBIN-RUSSWIN # ML2237LWAS26 LOCK WITHOUT CYLINDER. CYLINDERS PROVIDED AND INSTALLED BY OTHERS. BUTTS: STANLEY WORKS 138179.
- 6) PROVIDE 7" HIGH WIRE PARTITIONS AND 3" WIDE DOOR WITH TWO PADLOCK "STAPLES" AT 21" AND 83" AFF. PADLOCKS BY OTHERS. \*ACORN WIRE AND IRON WORKS TYPE NO. 130A OR APPROVED EQUAL LOCK TO BE KEYED SAME AS DOORS (NOTE 5 ABOVE).
- 7) IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS HE IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER AN ITEM ON THIS DOCUMENT IN ANY WAY. IF AN ITEM BEARING THE SEAL OF AN ENGINEER IS ALTERED, THE ALTERING ENGINEER SHALL AFFIX HIS SEAL AND THE NOTATION "ALTERED BY" FOLLOWED BY HIS SIGNATURE AND THE DATE OF SUCH ALTERATION, AND A SPECIFIC DESCRIPTION OF THE ALTERATION.


DOOR SCHEDULE

DOOR NO.	DOOR	FRAME						REMARKS
		OPENING SIZE	MAT'L	LVR/ U.C.	MAT'L	JLMS	HEAD	
801	2(3'-0" x 7'-0")	H.M.			H.M.			SEE NOTE 5 AND DOOR DETAIL ON THIS DRAWING
802	2(2'-8" x 7'-0")	H.M.			H.M.			SEE NOTE 5 AND DOOR DETAIL ON THIS DRAWING
803	3'-0" x 7'-0"	H.M.			STL			SEE NOTE 6

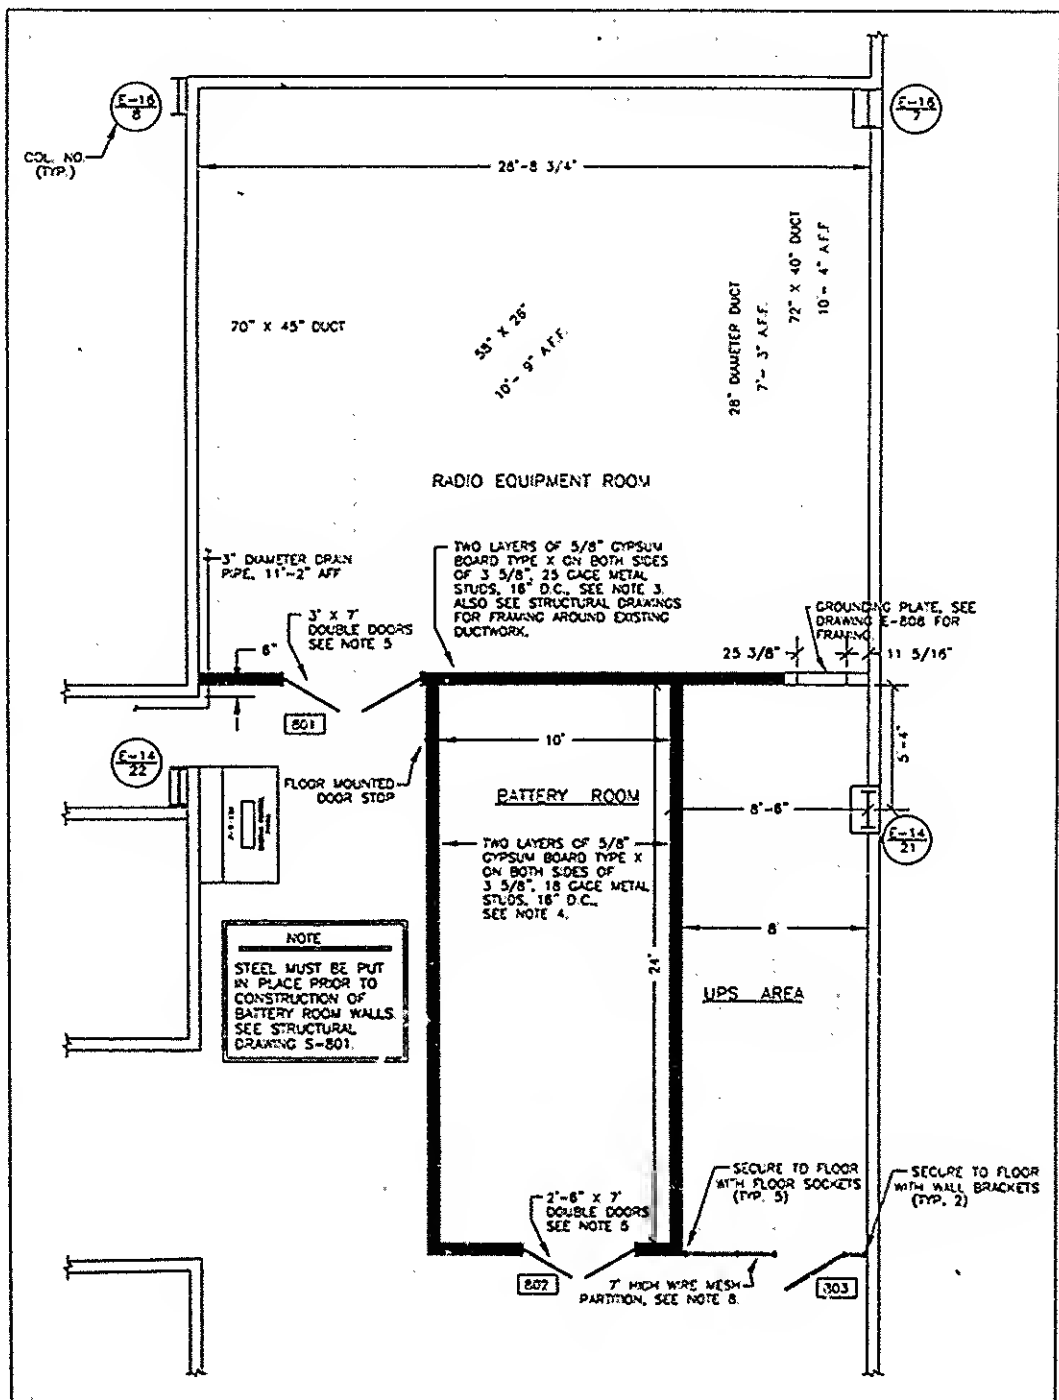


PARTIAL FLOOR PLAN


SCALE IN FEET

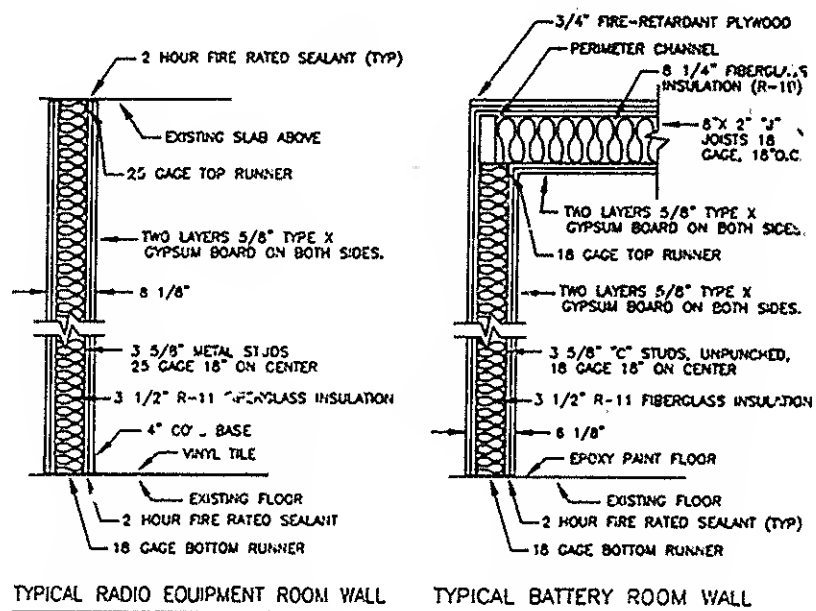


TYPICAL 2-HOUR FIRE RATED WALLS

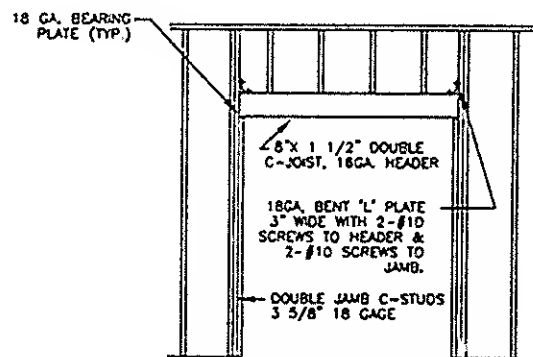


6' WIDE DOOR FRAMING DETAIL

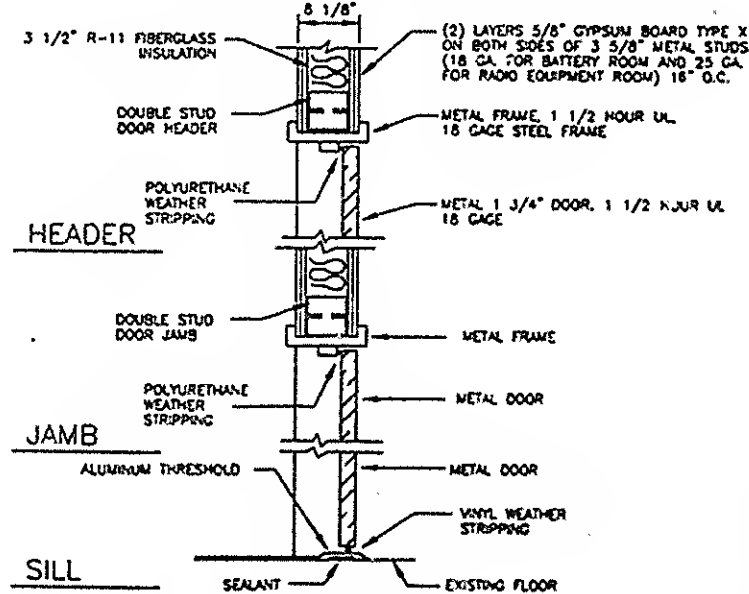

DOOR DETAIL

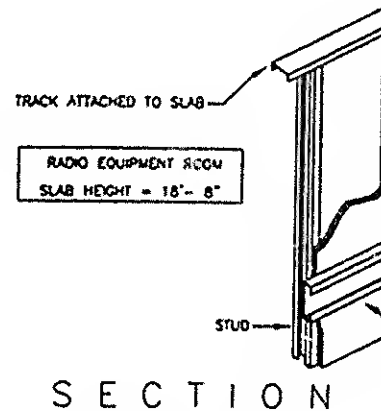

SECTION

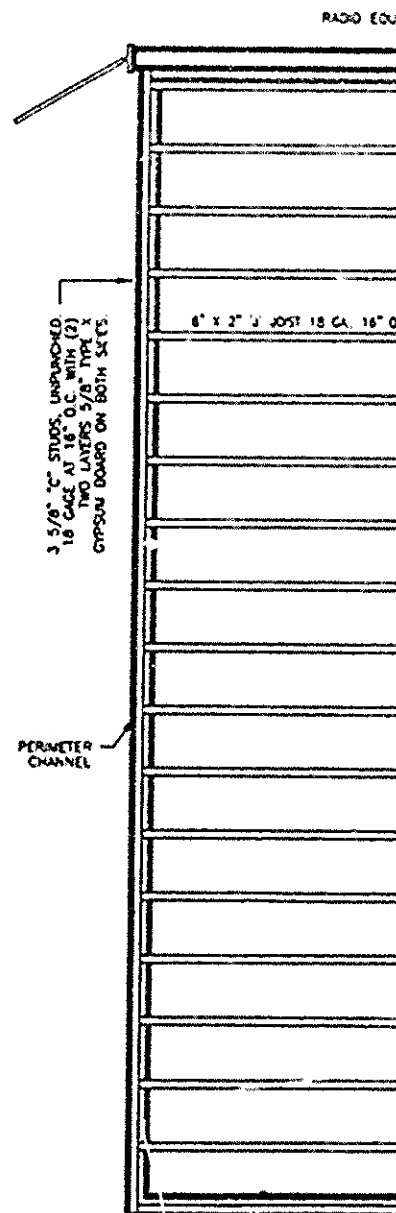

BATTERY ROOM CEILING

SCALE IN FEET